



## Appraising of Air Conditional System Condensate Discharge Rate in Southwest, Nigeria

O. S. Bamisaye<sup>1\*</sup>, P. K. Oke<sup>1</sup> and U. A. Essien<sup>2</sup>

<sup>1</sup>Department of Production and Industrial Engineering, Federal University of Technology, Akure, Nigeria.

<sup>2</sup>Department of Material and Metallurgical Engineering, Federal University of Technology, Minna, Nigeria.

### Authors' contributions

This work was carried out in collaboration between all authors. All authors read and approved the final manuscript.

### Article Information

DOI: 10.9734/JSRR/2018/45470

#### Editor(s):

(1) Dr. José Alberto Duarte Moller, Center for Advanced Materials Research, Complejo Industrial Chihuahua, Mexico.

#### Reviewers:

(1) Francisco Bulnes, Tecnológico de Estudios Superiores de Chalco, Mexico.

(2) Oludele Adebayo, Adeyefa, University of Ibadan, Nigeria.

(3) P. Cyklis, Cracow University of Technology, Poland.

Complete Peer review History: <http://www.sdiarticle3.com/review-history/45470>

Original Research Article

Received 19 October 2018  
Accepted 25 December 2018  
Published 17 January 2019

### ABSTRACT

**Aims:** The aim of this research is to ascertain the condensate discharge rate from a split air conditional system with a view to channeling the condensate into a storage tank for other useful purposes.

**Study Design:** Quantitative study. Relevant data on condensate discharge rate was collected.

**Place and Duration of Study:** Department of Mechanical Engineering, The Federal University of Technology, Akure, Ondo State, Nigeria, between 16<sup>th</sup> to the 22<sup>nd</sup> of November, 2015.

**Methodology:** The method used consists of data collection and readings such as outdoor dry bulb temperature, dew point temperatures, relative humidity, and condensate volume. It features the calculation of air conditioning load estimation, data analysis, and estimated cost of integrating condensate collection which is essential for the completion of this study.

**Results:** The study discovered that about three thousand four hundred and eighty-eight (3,488) litres of condensate are being wasted on a weekly basis within the School of Engineering and Engineering Technology, The Federal University of Technology, Akure. This figure indicates the amount of reclaimed water source that is not in use.

\*Corresponding author: E-mail: bamisayesylvester1988@gmail.com;

**Conclusion:** The condensate can/should be collected with the help of 2hp capacity pump and channeled through a pipe of diameter 32 mm into a 5000 litres capacity tank within the engineering building. The condensate can flow through the existing plumbing facilities and will serve to address a lot of water scarcities being experienced, most especially in many laboratories, toilets and by cleaners at School of Engineering and Engineering Technology Building. This will reduce the cost being spent per month on water supply by the faculty and would result to great annual savings.

*Keywords: Air condition; cooling load estimation; reclaim water; modern building.*

## 1. INTRODUCTION

Air conditioning can be referred as the process of simultaneous control of temperature, humidity, cleanliness and air motion for the comfort of human beings, animals or for the proper attainment of some industrial or scientific process [1]. The by-product of the simultaneous cooling in the air-conditioning system is the condensed water which is formed from moisture in the air. Therefore, condensate from air conditional is classified under the definition of alternative on-site sources of water such as rainwater to bolster water and decrease energy dissipated by town water operations [2]. The most efficient and vital use of condensate harvested from commercial or industrial buildings includes; toilet flushing, irrigation, ornamental water features, and process water, such as that used in manufacturing and makeup water in cooling towers.

It was reported by Guz [3] that high temperature and humidity during summer months contribute greatly to condensate production amounting to 6 to 7 ml/s/1000 m<sup>2</sup> of the cooled area of buildings. The weather in Ondo State, Southwest, Nigeria is characterized by maximum daytime temperatures which rarely exceed 34°C and low as 22°C, a mean annual relative humidity of about 80% [4]. Therefore, this makes it a good fit for condensate water recovery. Unfortunately, most buildings in Nigeria allows the condensate to typically drained away to an open ground as waste, which is an abundant source of reclaimed water. Hence, this paper aims to appraise the condensed water collected from a split-type air-conditioning system in a Nigerian office space.

## 2. LITERATURE REVIEW

Many types of research have been identified to determine the advantages of condensate recovery system in different places of the world. This study investigates some of this source of

these condensate recovery system and the importance. Bryant and Bryant [5] have found a modelling approach for determining condensate collection for an Institutional Building in Doha, Qatar. Results indicated that as the dew point temperature increased, the corresponding condensate of 2,498,100 litres (L) of water was captured from the condensate drains of the six hundred installed tons of air conditioning on a large commercial building in a location with one forty days of dew point temperatures above 16°C. Hassan and Hassan [6] reiterated the means of using the air-conditioning condensate as an added source of water. The results revealed that the enormous cost of implementing a condensate collecting system is still acceptable for buildings with high fresh air percentage. It was further observed that weather condition and space occupancy impact the volume of condensate generated. Lawrence et al. [7] presented a study of condensate modelling system for high performing buildings. The objective of the work was to develop a modelling system to estimate the amount of condensate from an air-conditional unit on an existing building. Some of the readings collected in the research work include; outdoor temperature, dew point and relative humidity of the fresh air and inside air conditional unit. The result showed that the total amount of condensate collected was 650,307 litres during the summer season with 13.24 litres per hour. Lawrence [8] founded a modelling prediction technique for an outdoor air-conditional unit with energy recovery, while using annual daily readings of average temperature and humidity data. The analysis of the result indicated that the condensate production from the case study building's large dedicated outdoor air-conditional unit can completely supplement the annual daily water closet and urinal water demand with  $6.12 \times 10^6$  litres of excess, which could be used to supplement landscape irrigation system. Johnson [9] research study revealed that the design of Heating, ventilation, and air conditioning (HVAC) systems in a sustainable laboratory facility will assist in high amounts of condensate recovery. The author revealed that

utilizing weather data information in a newly built laboratory in Atlanta, and an estimated cooling load, the appraised condensate collection from the cooling coils exceeded 3028330 L every year.

### 3. METHODOLOGY

This study approached the subject of condensate collection with three specific purposes. It started with the development of a technique to identify the total volume of condensate collected using correlations with weather data. The next stage involves evaluating the method associated with a typical condensate collection system. Finally, the result collected was analysed for generalizations regarding environments where condensate collection would be recommended for the economic and environmental impact perspective.

#### 3.1 Materials

A split type air-conditional unit (2500 W), graduated measuring cylinder (500 ml), thermo-hygrometer, collector (25 litres) and drainpipe (using 25 mm PVC adaptor).

#### 3.2 Selection of Environment and Condensate Collection

This project collected condensate data for a period of 1 week in November 2015. After the

problem with continuous power failure was corrected, data collection really started on November 16<sup>th</sup>, 2015. The study was carried out in an office space within the School of Engineering and Engineering Technology, Federal University of Technology, Akure, Ondo State, Nigeria. The hourly values of dry bulb temperatures, and relative humidity with operating conditions of the air handling unit give the typical condensate rate for each hour. The condensate produced for each specific hour was added to compute the condensate for that specific day. Precautions taken to enhance accuracy in measurement of condensate includes, calibration of the thermo-hygrometer apparatus used for the study to avoid errors associated with dry bulb temperature and relative humidity readings. The condensate collector was constantly checked to verify that there are no leaks. Although this study only looked at an office space within the school of engineering building, developing correlations between the amount of condensate and weather data parameters allows the results and conclusions to be applicable anywhere. The first step toward achieving this goal was to check if the correlation can be derived for the amount of condensate collection with respect to a readily available weather data parameter. The office space can accommodate at least four people and its volume was 33.8 m<sup>3</sup>. The room plan of the office space is shown in Fig. 1.

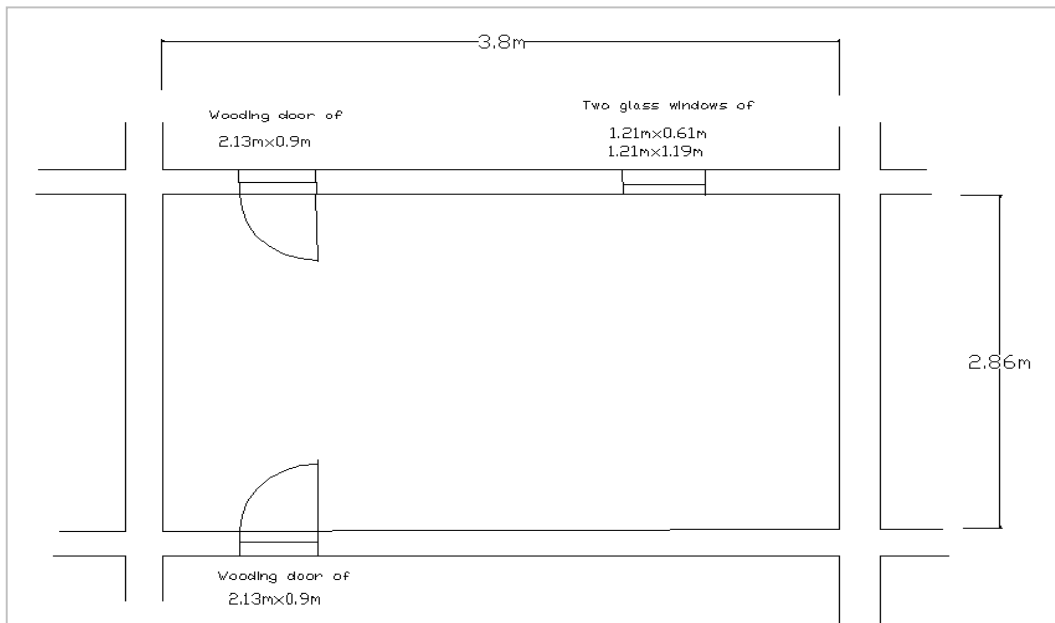


Fig. 1. Room plan of the office space

### 3.3 Sizing and Installation of the Split Air-Conditioning System

According to Geshwiler [10], the occupancy activity impacts the fresh air ratio which may differ from 100% fresh air in operations like a kitchen, laundry room, and electrical room (where there is a presence of a pure sensible load). To calculate the cooling load of a building's volume, the effect of heat stored in the mass of the building has made it difficult due to its thermal inertia to heat response. Therefore, the sizing of the air conditional system for room conditioning should start with the theory of air conditioning load estimation in buildings and analysis of heat transfer in a typical sample of building construction. In order to achieve this, the Cooling Load temperature difference (CLTD) and Glass Load Factor (GLF) approach were developed by [11]. Therefore, the conductive transfer across the wall surfaces or roof is defined in the form;

- **Roof Construction**  
Conventional roof-attic-ceiling combination  
 $U = 0.28 \text{ W/(m}^2\text{K)}$
- **Wall Construction**  
Brick, insulation, brick wall  $U = 0.34 \text{ W/(m}^2\text{K)}$   
Partition wall  $U = 0.4 \text{ W/(m}^2\text{K)}$
- **Doors**  
Wood, solid core  $U = 1.82 \text{ W/(m}^2\text{K)}$
- **Windows**  
Clear louver-pane glass in metal frames  
3mm thick.  $U = 2.84 \text{ W/(m}^2\text{K)}$   
The window glass has a 600 mm overhang at the top.  
Assume closed, medium-color Venetian blinds.
- **Outdoor Design Conditions**  
A temperature of 33°C dry bulb with a 13 K daily range  
Relative humidity ratio of 0.0136 kg vapour/kg dry air (23.7°C wet bulb)
- **Indoor Design conditions**  
A temperature of 22°C dry bulb  
Relative humidity ratio of 55%
- **Occupancy**  
Four persons
- **Appliances and lights**  
110 W for the light fittings and 150% for the appliances in the office

From the sensible, latent and total cooling load

- **Heat gains**  
For walls, roof, and doors  
 $Q = U \cdot A \cdot (\text{CLTD})$  (1)

Where,  
 $U$  = coefficient of heat transfer  $\text{W/(m}^2\text{k)}$ ;  $A$  = area of surface,  $\text{m}^2$ ,  
 $\text{CLTD}$  = Cooling Load Temperature Difference,  $\text{K}$

- For Walls  
 $Q = 0.34 \times 33.8 \times 14$   
 $Q = 161 \text{ W}$
- For Partition  
 $Q = U \cdot A \cdot (\text{CLTD})$   
 $Q = 0.4 \times 33.8 \times 4$   
 $Q = 54 \text{ W}$
- For Roof  
 $Q = U \cdot A \cdot (\text{CLTD})$   
 $Q = 0.28 \times 10.86 \times 27$   
 $Q = 82 \text{ W}$
- For Doors (Two numbers)  
 $Q = 2 (U \cdot A \cdot (\text{CLTD}))$   
 $Q = 2 (1.82 \times 1.17 \times 14)$   
 $Q = 60 \text{ W}$
- For Window – considering the overhang louver and curtain ( $H=2\text{m}$ )  
 $Q = 2(A \cdot (\text{GLF}))$  (2)  
Where  $\text{GLF}$  = glass load factor;  $A$  = area of surface,  $\text{m}^2$ ,  
 $Q = 2 (1.416 \times 141)$   
 $Q = 399 \text{ W}$

- For Occupancy  
 $Q = 67 \text{ Wn}$  (3)  
 $\text{Wn}$  = no of persons  
 $Q = 67 \times 4$   
 $Q = 268 \text{ W}$

- Volumetric airflow rate for summer sensible heat  
 $\dot{V} = \text{ACH} \cdot V \cdot 1000/3600$  (4)

$\dot{V}$  = Volumetric airflow rate  $\text{l/s}$ ;  $V$  = Volume of room  $\text{m}^3$   
 $\text{ACH}$  = Summer air change rate  $\text{l/h}$   
 $V = 0.5 \times 33.8 \times 1000/3600$   
 $V = 4.69 \text{ l/s}$

**Table 1. Cost analysis of integrating condensate collection to existing engineering building**

S/N	Materials description	Specifications	Quantity	Unit cost (₦)	Total cost (₦)
1	GPee Storage Tank with all necessary accessories	5000 L	1	70,000.00	70,000.00
2	Lowara Booster Water Pump (Duty/Assist)	2 Hp, 20 L/min	1 set	210,000.00	210,000.00
3	Electrical Installation and control panel	lot			75,000.00
4	Plumbing Work and Piping Fittings	32 mm Diameter			50,000.00
5	Contingencies				100,000.00
	Total				₦505,000.00

- Infiltration  
 $Q = 1.2 \cdot \dot{V} \cdot \Delta t$  (5)

Where  $\Delta t$  = Outside and inside design temperature respectively (°C)

Where  $\dot{V}$  = Volumetric airflow rate l/s  
 $Q = 1.2 \times 4.69 \times (33-22)$   
 $Q = 62 \text{ W}$

- Total Heat Gain (6)  
 $Q = \text{Latent heat} + \text{sensible heat}$   
 $Q_{\text{total}} = 1303 \text{ W}$

The result in Table 2 showed that a total of 42.03 Litres of condensate was harvestable between the time periods from the split air conditioning unit serving the office under study. The result collated also indicated that the figure could rise to as much as 3,488 L a week if the entire 83 numbers of split air conditioning unit serving offices within the building are functioning. This figure indicates the amount of reusable water source that is not in use. The total volume of condensate harvested within the school of engineering and engineering technology building will be vital in complementing the primary water source such as watering of the landscape area, the source of water in the toilets and rinsing laboratory apparatus. The summary of the condensate collected for seven days is shown in Table 2.

### 3.4 Cost Estimate

This is the overview of the cost of materials needed for installing piping fittings, accessories and electrical connectors in condensate collection. The estimated cost of integrating condensate collection to existing plumbing works of toilet and laboratory in the engineering building of the Federal University of Technology, Akure is shown in Table 1.

## 4. RESULTS AND DISCUSSION

The results presented here cover a week period from the 16<sup>th</sup> to the 22<sup>nd</sup> of November, 2015. The concurring outdoor dry bulb temperature, relative humidity, and dew point temperatures during this period were also recorded. During this period, condensate collection varied from almost low quantity (0.41 L/hr) to what appears to be highest (1.55 L/hr) from the outdoor air unit. The split air conditioning unit serves only the office under study and it is a one fan unit with provisions for outside air, return air and nominal cooling capacity of 2500 W. The average outdoor temperature and relative humidity during this period ranges from 26°C – 31°C and 52% – 68%.

It was observed in Fig. 2. & Table 2. that increase in average temperature, average dew point and high amount of average relative humidity brings about a corresponding increase in the amount of condensate collected. Thus, the greater the relative humidity at a given temperature, the greater volume of the condensate formed and vice versa. The high dew point recorded means there is a large amount of moisture present in the air and this can be further interpreted that higher dew point temperature brings about a large amount of relative humidity. The result agrees with the works of [7] and [9] who found that high relative humidity with corresponding dry bulb outdoor temperature and dew point gives rise to high volume of condensate that will be collected from an air conditioning system. Finally, as the temperature rises during the daytime, the relative humidity for the corresponding time decreases and It can be said that the temperature is generally inversely proportional to the relative humidity.


**Table 2. Showing the evaluation of condensate collection for five days**

S/N	Day	Average relative humidity (%)	Average temperature (°C)	Average dew point (°C)	Condensate collected (Liters)
1	Day 1	57%	26	23	6.17
2	Day 2	68%	29	21	6.85
3	Day 3	52%	29	21	4.74
4	Day 4	59%	30	22	5.83
5	Day 5	64%	29	21	5.91
6	Day 6	65%	29	21	6.25
7	Day 7	60%	31	23	6.28

Total Condensate Collected in SEET (x 1 A/C Unit) 42.03 L

**Net Total for 83 no(s) of A/C unit Installed & Functioning 3,488 L**

The time for data collections per day is average of 8 hours or 480 minutes

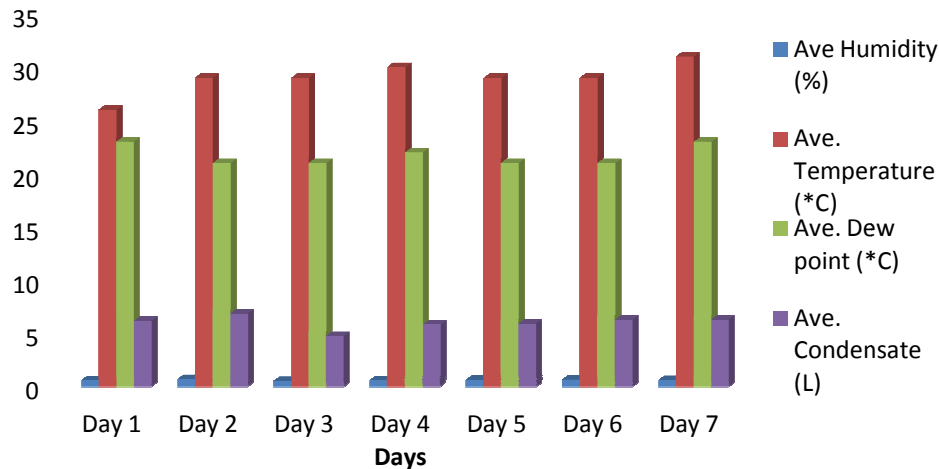

**Fig. 2. Variations of average humidity, temperature, dew point and condensate against different days**

### 5. CONCLUSION

The aim of the study is to apply techniques in appraising condensate collection potential and to determine if condensate collection would be recommended for the main water source. The application of reclaimed water source such as collected condensate is one approach for reducing long-term potable water consumption and reduce the cost being spent per month on water supply. The imbalance in the water supply and demand currently experienced at the engineering building can be managed effectively

if the condensate is properly collected. Water and energy are conjoint and hence it is essential that building operators and industry leaders understand that water conservation is as important as energy conservation. The study discovered that about three thousand four hundred and eighty-eight (3,488) litres of condensate are being wasted on a weekly basis within the School of Engineering and Engineering Technology. Therefore, the condensate collected should be channeled through a pipe of diameter 32 mm into a 5000 litres capacity tank with the help of 2hp capacity pump within the engineering

building. The condensate can flow through the existing plumbing facilities to the restrooms and laboratory for good use.

## COMPETING INTERESTS

Authors have declared that no competing interests exist.

## REFERENCES

1. Jones WP. Air conditioning engineering. Elsevier Science & Technology Books. First Edition, USA. 2001; ISBN: 0750650745.
2. American Society of Heating, Refrigerating, and Air-Conditioning Engineers. The Standard for the Design of High Performance Green Buildings. 2014;189.1-2014.
3. Guz K. Condensate water recovery. Journal of American Society of Heating, Refrigerating, and Air-Conditioning Engineers. 2005;47:54–56.
4. NIMET. Nigeria daily weather forecast. 2015. Accessed on 20 March 2015. Available:www.nimet.gov.ng/weather/akure/Nigeria.
5. Bryant JA, Ahmed T. Condensate water collection for an institutional building in Doha, Qatar. Paper presented at the sixteenth symposium on improving building systems in hot and humid climates, Dallas, Texas. 2008;15-17.
6. Hassan M, Bakry S. Feasibility of condensate recovery in humid climates. International Journal of Architecture, Engineering and Construction. 2013;271-279.
7. Lawrence T, Perry J, Dempsey P. Capturing condensate by retrofitting AHUs. Journal of the American Society of Heating, Refrigerating and Air Conditioning Engineers. 2010;52:48–54.
8. Painter F. Condensate harvesting from large dedicated outside air-handling units with heat recovery. Journal of American Society of Heating, Refrigerating, and Air-Conditioning Engineers. 2009;115:573–580.
9. Johnson GR. Heating, ventilating and air-conditioning design for sustainable laboratory facility. Journal of American Society of Heating, Refrigerating, and Air-Conditioning Engineers. 2008;24-34.
10. Geshwiler M. American society of heating, refrigerating, and air-conditioning engineers pocket guide. Guide for Air Conditioning, Heating and Ventilation. Second Edition, Atlanta, United States. 2005; ISBN-10:1-931862-78-8.
11. American Society of heating, refrigerating, and air-conditioning engineers. The ASHRAE Handbook: Fundamentals. 2001;608-621.

© 2018 Bamisaye et al.; This is an Open Access article distributed under the terms of the Creative Commons Attribution License (<http://creativecommons.org/licenses/by/4.0>), which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

*Peer-review history:*

*The peer review history for this paper can be accessed here:  
<http://www.sdiarticle3.com/review-history/45470>*